




Sample Hospitality - Diagram 301

Single PTAC units serving individual rooms (WIRELESS thermostat)

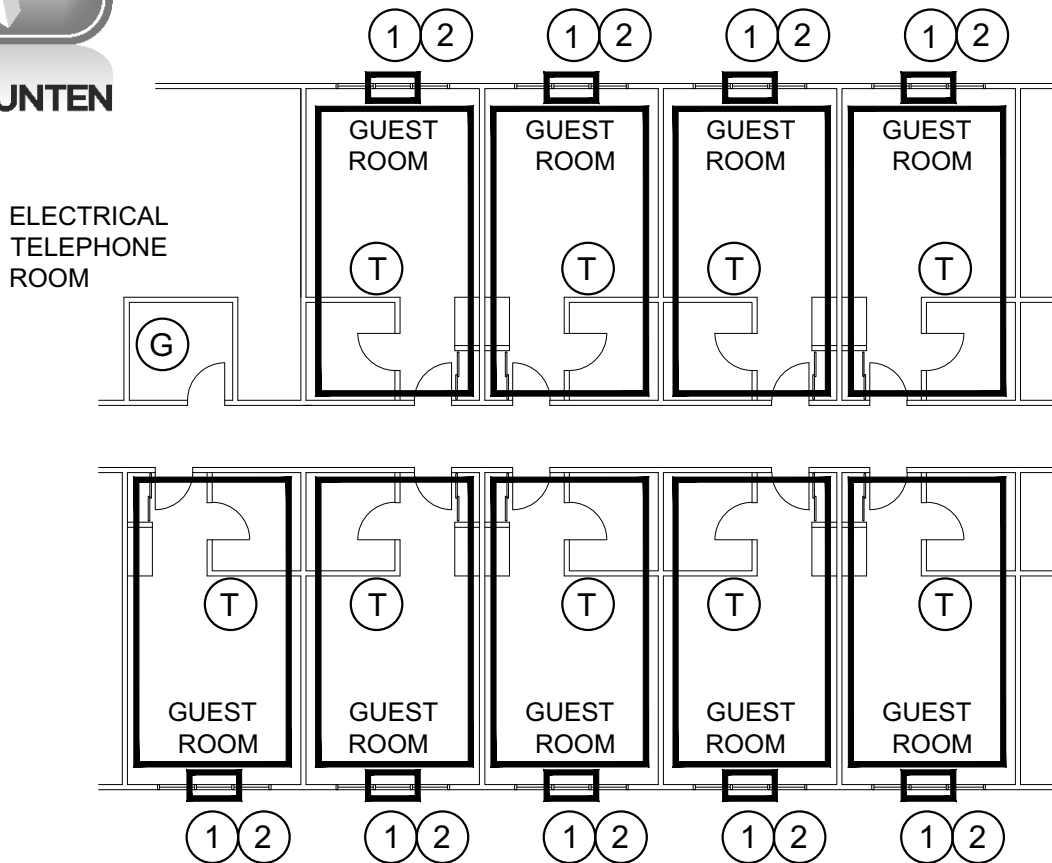

- (G)** New FOUNTEN Wireless Gateway (Part No. FS-GATEWAY) - recommend one per building. Unit has 100 to 300 foot maximum wireless range to nearest thermostat depending on building materials. A single Gateway can support up to 2,000 thermostats. Requires 110V electrical outlet and out-bound data connection. Can be located anywhere in building - central location recommended, cannot be surrounded by metal.
- (T)** New FOUNTEN Wireless Thermostat (Part No. FS-TRW-32DC) installed on wall at new location. Installation requires one thermostat per PTAC unit. Requires thermostat controller module (Part No.FS-TCM) installed at PTAC unit.
- (1)** Existing PTAC (Package Terminal Air Conditioner) unit.
- (2)** Thermostat Control Module (Part No. FS-TCM) required where existing PTAC does not have wired thermostat. Required to establish wireless communication to new wall mounted thermostat (FS-TRW-32DC).

NOTE: PTAC unit must be equipped with internal terminal connectors for auxiliary wall thermostat.

Installation not recommended in new buildings. See Diagram 300 (WIRED thermostat) FOUNTEN 2013